


# Air Stripping Towers

## Recommended Inspection Services

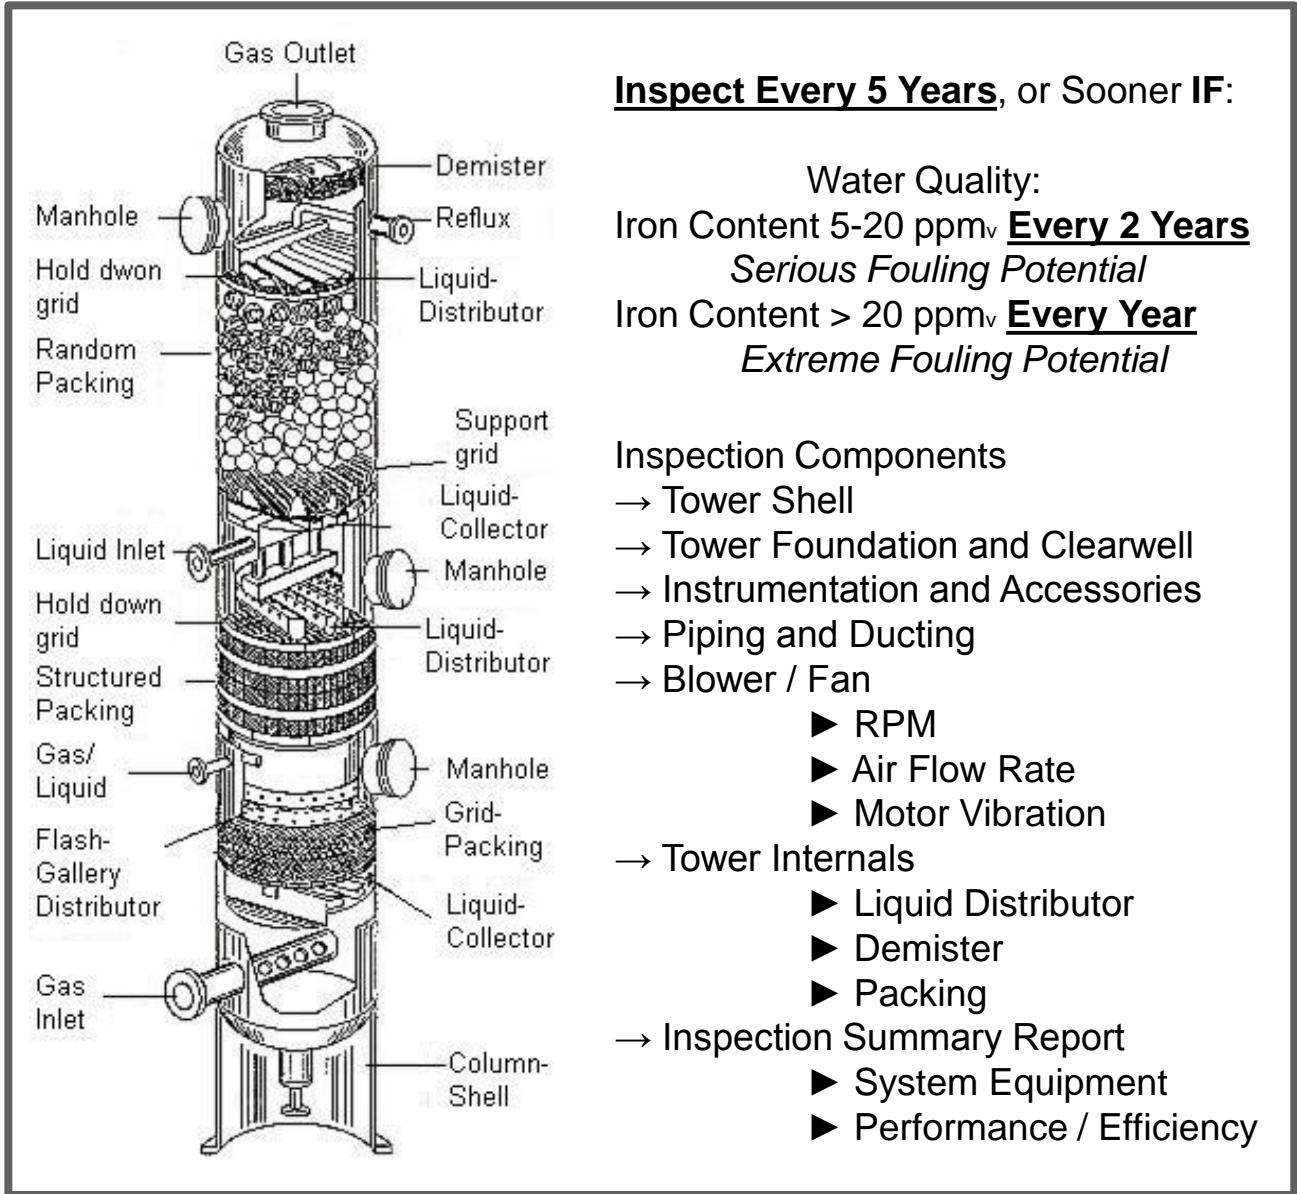

**Inspect Every 5 Years, or Sooner IF:**

Water Quality:  
 Iron Content 5-20 ppm<sub>v</sub> **Every 2 Years**  
*Serious Fouling Potential*  
 Iron Content > 20 ppm<sub>v</sub> **Every Year**  
*Extreme Fouling Potential*

### Inspection Components

- Tower Shell
- Tower Foundation and Clearwell
- Instrumentation and Accessories
- Piping and Ducting
- Blower / Fan
  - ▶ RPM
  - ▶ Air Flow Rate
  - ▶ Motor Vibration
- Tower Internals
  - ▶ Liquid Distributor
  - ▶ Demister
  - ▶ Packing
- Inspection Summary Report
  - ▶ System Equipment
  - ▶ Performance / Efficiency

For more information and design assistance, fill out the online inquiry on Contact-Us page.

Or contact us directly:

**Raschig USA, Inc.**

*Formerly Raschig Jaeger Technologies*

2201 E. Lamar Blvd. #240

Arlington, TX 76006

800-678-0345

817-695-5680

info@raschig-usa.com

IMPORTANT: The following supercedes Buyer's Documents. SELLER MAKES NO REPRESENTATION OR WARRANTY, EXPRESS OR IMPLIED, INCLUDING OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE. No statements herein are to be construed as inducements to infringe any relevant patent. Under no circumstances shall Seller be liable for incidental, consequential or indirect damages for alleged negligence, breach of warranty, strict liability, tort or contract arising in connection with the product(s). Buyer's sole remedy and Seller's sole liability for any claims shall be Buyer's purchase price. Data and results are based on controlled or lab work and must be confirmed by Buyer by testing for intended conditions of use. The product(s) has not been tested for, and is therefore not recommended for, uses for which prolonged contact with mucous membranes, abraded skin, or blood is intended; or for uses for which implantation within the human body is intended.